

IN-SITU ZIRCONIA OXYGEN ANALYZER

DATA SHEET

ZFK8, ZKM, ZTA

This oxygen analyzer is used to continuously measure oxygen concentration in combustible exhaust gas of industrial boilers or furnaces, and is ideally suited for combustion management and control.

The analyzer system is comprised of the detector and converter coupled together as a complete system. Detector setting configuration includes the detector flow tube and detector sensor. The flow tube is inserted directly into the gas and directs gas to the sensor for measurement. The converter (ZKM) is comprised of the signal processor, input/output and communications, display and system controls.

The converter is equipped with advanced functionality such as performing the sensor diagnostics and sensor recovery function, so the detector can be used within long term stability.

FEATURES

- Gas sampling device is unnecessary**
For quick response, insert the detector directly into the flue Gas sampling functions such as a gas aspirator and a dehumidifier are not required.
- Easy maintenance**
The sensor equipped with the detector, has unit construction, it is easy to replace.
By separating the detector and the flow guide tube, filter replacement is easy.
- More reliable than sensor diagnosis, sensor recoverable function**
Depending on the concentration of the measurement gas, the power of the sensor might deteriorate. The equipment includes sensor recovery function electronically, checking the deterioration status of the sensor depletion.
Therefore, it has high reliability and long-lasting stability.
- Safe and secure**
System detects thermocouple break for heater control on the sensor side. Safety functions of isolating power supply to the detector or isolating power via external contact input are also.
- Easy operation**
The operation and setting for the converter can be performed interactively, and available as English, Japanese or Chinese for language display.



General-use detector (ZFK8)



High-temperature detector (ZTA)



<IP66>
Converter (ZKM1)



<IP67>
Converter (ZKM2)

SPECIFICATIONS

General Specifications

Measuring object: Oxygen in noncombustible gas

Measuring method:

Directly insert type zirconia system

Measuring range: 0 to 2 ... setting range at option 2 in 50 vol% O₂
(in 1 vol% O₂ steps)

Repeatability: Within ±0.5%FS

Linearity: Within ±2%FS

Response time: Within 4 to 7 sec, for 90% (from calibration gas inlet)

Warmup time: More than 10 min

Analog output: 4 to 20mA DC (allowable load resistance less than 500Ω) or 0 to 1V DC (output resistance more than 100Ω)

Power supply: Rated voltage;
100 to 120V AC (operating voltage 90 to 132V AC)
200 to 240V AC (operating voltage 190 to 264V AC)
Rated frequency; 50/60Hz

Power consumption: Maximum 240VA (Detector: approx. 200VA, Converter: approx. 40VA)
Normal 70VA (Detector: approx. 50VA, Converter: approx. 20VA)

Detector Specifications (ZFK)

Measured gas temperature:

Flow guide tube system; -20 to +600°C (for general-use, corrosive gas)
Ejector system; -20 to +1500°C (for high-temperature gas)
-20 to +800°C (for general-use)

Measured gas pressure:

-3 to +3kPa (-306 to +306mmH₂O)

Flow guide tube:

With or without blow-down nozzle
Flange; JIS5K 65A FF
(JIS5K-80AFF for high particulate gas)
Insertion length; 0.3, 0.5, 0.75, 1m
(0.8m for high particulate gas)

Ejector (general-use):

Probe for guiding measured gas to detector
Flange; JIS10K 65A RF
Insertion length; 0.5, 0.75, 1, 1.5m (according to customer's specification)

Operating temperature:

-10 to +60°C for Primary detecting element
-5 to +100°C for ejector section
125°C or less at detector flange surface with power applied

Storage temperature:

Sensing element: -20 to +70°C
Ejector: -10 to +100°C

Structure:

Dust/rain-proof structure(IEC IP66 equivalent)

Filter:

Alumina(filtering accuracy 50µm) and quartz paper

Main materials of gas-contacting parts:

Detector; Zirconia, SUS316, platinum
Flow guide tube; SUS304 or SUS316
Ejector (general use); SUS316, SUS304
Ejector; (for high temperature) SiC, SUS316, SUS304

Calibration gas inlet:

φ6mm tube join or φ1/4-inch tube join (as specified)

Reference air inlet (option):

φ6mm tube join or φ1/4-inch tube join (as specified)

Detector mounting:

Horizontal plane ±45°, ambient surrounding air should be clean.

Outer dimensions: (L × max. dia.) 210mm × 100mm (detector)

Mass (approx.) {weight}:

Detector; 1.6kg
Ejector; 15kg (insertion length 1m)
Flow guide tube (general-use, 1m); 5kg

Finish color:

Silver and SUS metallic color

Ejector air inlet flow rate:

5 to 10 L/min

Calibration gas flow:

1.5 to 2 L/min

Blowdown air inlet pressure:

200 to 300kPa {2 to 3 kgf/cm²}

Ejector exhaust gas processing:

Within furnace, returned to flue

Heater temperature drop alarm output (ejector):

Alarm output when below 100°C Me-

chanical thermostat

N.O. (1a) contact, 200V AC, 2A

Converter specification (ZKM)

Concentration value indication:

Digital indication in 4 digits

Contact output signal:

(1) Contact specification; 6 points, 1a 250V AC/3A or 30V DC/3A
(2) Contact function;

- Under maintenance
- Under blowdown Note3)
- Span calibrating gas
- Zero calibration gas
- Instrument anomalies Note1)
- Alarm Note2)

Note1) The following Instrument errors (1) Thermocouples break (2) Sensor break (3) Temperature fault (4) Calibration fault (5) Zero/span adjustment fault (6) Output error turn the contact-ON

Note2) Alarm selects just one as mentioned below (1) High (2) Low (3) Upper and Lower (4) High-high (5) Low-low, it turns ON while operating.

Note3) Under blow down is available in case of option, and it turns ON while operating.

Contact input signal:

(1) Contact specification; 3points (the following option) ON; 0V (10mA or less), OFF; 5V

(2) Contact function;

- External hold
- Calculation reset
- Heater OFF
- Blow down (option)
- Inhibition of calibration
- Calibration start
- Range change

Calibration method:

- (a) Manual calibration with key operation
- (b) Auto. calibration (option)
Calibration cycle; 00 day 00 hour to 99 days 23 hours
- (c) All calibration

Calibration gas:

- Range settings
Zero gas; 0.010 to 25.00% O₂
Span gas; 0.010 to 50.00% O₂
- Recommended calibration gas concentration
Zero gas; 0.25 to 2.0% O₂
Span gas; 20.6 to 21.0% O₂
(oxygen concentration in the air)

Blowdown:

A function for blowing out with compressed air dust that has deposited in the flow guide tube. Blowdown can be performed for a predetermined time and at predetermined intervals.

(option)

Blowdown cycle; 00 hour 00 minute to 99 hours 59 minutes

Blowdown time; 0 minute 00 second to 0 minutes 999 seconds

Output signal hold:

Output signal is held during calibration, processing recoverable sensor, warm-up, and blowdown. The hold function can also be released.

Cock (option): Selects zero or span gas during manual zero or span calibration. Mounted on the side of the converter.

Communication function:
RS232C (MODBUS) standard specification
RS485 (MODBUS) (option)

Combustion efficiency display (option):
When you select this display, "rich mode display" will be an simultaneous display. This function calculates and displays combustion efficiency from oxygen concentration and measured gas temperature.
Thermocouple (R) is required for temperature measurement.

Operating temperature:
-20 to +55°C

Operating humidity:
95% RH or less, non condensing

Storage temperature:
-30 to +70°C

Storage humidity: 95% RH or less, non condensing

Construction: Dust-proof, rainproof construction (corresponding to IP66 or IP67 of IEC)

Material: Aluminum case

Outer dimensions (H x W x D):
170 X 159 X 70mm (IP66)
220 X 230 X 95mm (IP67)

Mass (weight): IP66: Approx. 2kg (excluding cable and detector)
IP67: Approx. 4.5kg (excluding cable and detector)

Finish color: IP66: Case: Silver
Cover: Pantone Cool Gray 1C-F
IP67: Munsell 6PB 3.5/10.5 (blue)
Cover: Silver (case)

Mounting method: Mounted flush on panel or on pipe

Electrical Safety:

Overvoltage category
; II power supply input
; I relay interfaces
(IEC1010-1)
External overcurrent protective device
; 10A
Equipment interfaces are safety separated (SELV)

The product conforms to the requirements of the Electromagnetic compatibility Directive 89/336/EEC as detailed within the technical construction file number TZ734575. The applicable standards used to demonstrate compliance are :

EN 55011 : 1992 CLASSA Conducted and Radiated emissions

EN 50082-1 : 1992 Radiated immunity, ESD and FBT

CODE SYMBOLS

(Detector)

ZFK		4	5	6	7	8	9	10	11	12	13	14	15	16	Description
8	R					5								1	Cal. gas inlet For φ6mm tube (SUS) For φ1/4 inch tube (SUS)
														3	Power supply 100 to 120VAC 50/60Hz 200 to 240VAC 50/60Hz CE
															Flow guide tube flange application length
							0	Y	0						None
							5	A	3						SUS304 general use 300mm
							5	A	5						SUS304 general use 500mm
							5	A	7						SUS304 general use 750mm
							5	A	1						SUS304 general use 1000mm
							5	B	3						SUS316 for corrosive gas 300mm
							5	B	5						SUS316 for corrosive gas 500mm
							5	B	7						SUS316 for corrosive gas 750mm
							5	B	1						SUS316 for corrosive gas 1000mm
							5	C	3						SUS316 with blow-down nozzle 300mm
							5	C	5						SUS316 with blow-down nozzle 500mm
							5	C	7						SUS316 with blow-down nozzle 750mm
							5	C	1						SUS316 with blow-down nozzle 1000mm
							6	D	8						SUS316 for high particulate 800mm
							6	E	8						SUS316 for high particulate with cover 800mm
							Z	Z	Z						Others
															Protection cover Without With
															Reference air inlet Non For φ6mm tube (SUS) For φ1/4 inch tube (SUS)
															Filter spec. Standard
															Instruction manual language Japanese English Chinese
															Specification name plate 1 Standard (100 to 120V AC 50/60Hz) 2 Standard (200 to 240V AC 50/60Hz)

(Replacement Detector element)

Power supply	Code symbols
100 to 120V AC	ZFK8YY15-0Y0YY-0YY
200 to 240V AC	ZFK8YY35-0Y0YY-0YY



(Converter)

1	2	3	4	5	6	7	8	9	10	11	12	Description			
Z	K	M												Construction	
	1													IP66	
	2													IP67	
		B												Output signal	
		E												4 to 20mA DC	
		Z												0 to 1V DC	
														Other	
														Communication function	
	1													RS-232C	
	2													RS-485	
														Mounting bracket	
	1													Mounting on panel surface	
	2													Pipe mounting	
														Optional Functions	
								Y						None	
								1						Combustion efficiency display function Note4)	
								2						Blowdown	
								3						Auto calibration	
								4						Combustion efficiency indication + Blowdown Note4)	
								5						Combustion efficiency indication + Auto calibration Note4)	
								6						Blowdown + Auto calibration	
								7						Combustion efficiency indication + Blowdown + Auto calibration Note4)	
														Display language	
								J						Japanese	
								E						English	
								C						Chinese	
														Cock (Specify none when the analyzer has auto calibration function.)	
								Y						Without	
								1						With	

Note4) When you select this display, rich mode will be a simultaneous display.

(Exclusive-special cable)

1	2	3	4	5	6	7	8	9	Description			
Z	R	Z	K	R							Connectable devices	
											For ZKM	
											Types	
											For R thermocouple	
											Conduit length	
											Cable length	
											YA --- None 6m	
											YB --- None 10m	
											YC --- None 15m	
											YD --- None 20m	
											YE --- None 30m	
											YF --- None 40m	
											YG --- None 50m	
											YH --- None 60m	
											YJ --- None 70m	
											YK --- None 80m	
											YL --- None 90m	
											YM --- None 100m	
											AA --- 6m 6m	
											BB --- 10m 10m	
											CC --- 15m 15m	
											DD --- 20m 20m	
											Cable end treatment	
											0 --- None	
											1 --- One side (detector side)	
											2 --- Both sides	

Note5) For connection between detector and converter, the conduit to be used should be rainproof flexible type.

(Ejector)

1	2	3	4	5	6	7	8	Description			
Z	T	A								Measured gas temperature	
	1									For high temperatures (+1500°C max.)	
	2									General-use (+800°C max.)	
										Insertion length [mm]	
										B --- 500	
										C --- 750	
										D --- 1000	
										E --- 1500	
										Power supply	
	1									100V/115V AC 50/60Hz	
	3									200V/220V AC 50/60Hz	
	5									230VAC 50/60Hz	

SCOPE OF DELIVERY

Detector: Detector main unit × 1, Viton O ring × 1, mounting screw (M5mm × 16) × 6, thermal sticker × 1, flow guide tube (as specified) × 1, ceramic filter × 1, rain-proof cover (as specified) × 1, Instruction manual × 1

Converter: Converter main unit × 1, mounting bracket set, (as specified) × 1
Accessories (AC250V 500mA T fuse × 2, AC250V 2.5A T fuse × 2), Instruction manual × 1

Ejector: Ejector main unit × 1, insertion tube × 1, M16mm nut, and washer × 4, packing × 1

Items to be prepared separately:


- Standard gas for calibration
Type ZBM□NSH4-01 (up to 5% O₂ range)
Type ZBM□NSJ4-01 (over 5% O₂ range)
- Reduction valve for standard gas (type ZBD61003)
- Flowmeter
Type; ZBD42203, 0.2 to 2L/min (for calibrating gas)
Type; ZBD42403, 1 to 10L/min (for ejector)

CAUTIONS

- If combustible gas (CO, H₂ etc.) exists in the measured gas, error will occur due to burning at the sensor section. The inclusion of corrosive gas (Si vapor, alkaline metal, P, Pb etc.) will shorten the life of the sensor.
- When the measured gas temperature is high (+300°C or higher), the flange should be separated from the furnace wall in order to bring the detector flange surface temperature below the specified value (+125°C). The flow guide should be attached in the direction in which the gas flow to the detector decreases.
- When much dust is included in the gas, the flow guide tube should be attached at an inclination so that the flow goes from below to above. And the flow guide should be attached in the direction in which the gas flow to the detector decreases.
- In the case of a refuse incinerator, automatic blow down of the flow guide should not be performed (to prevent corrosion of the flow guide tube due to drainage). Blow-down should be performed manually when change in the indication has become very little with the furnace stopped.


CONFIGURATION

Flow guide tube system

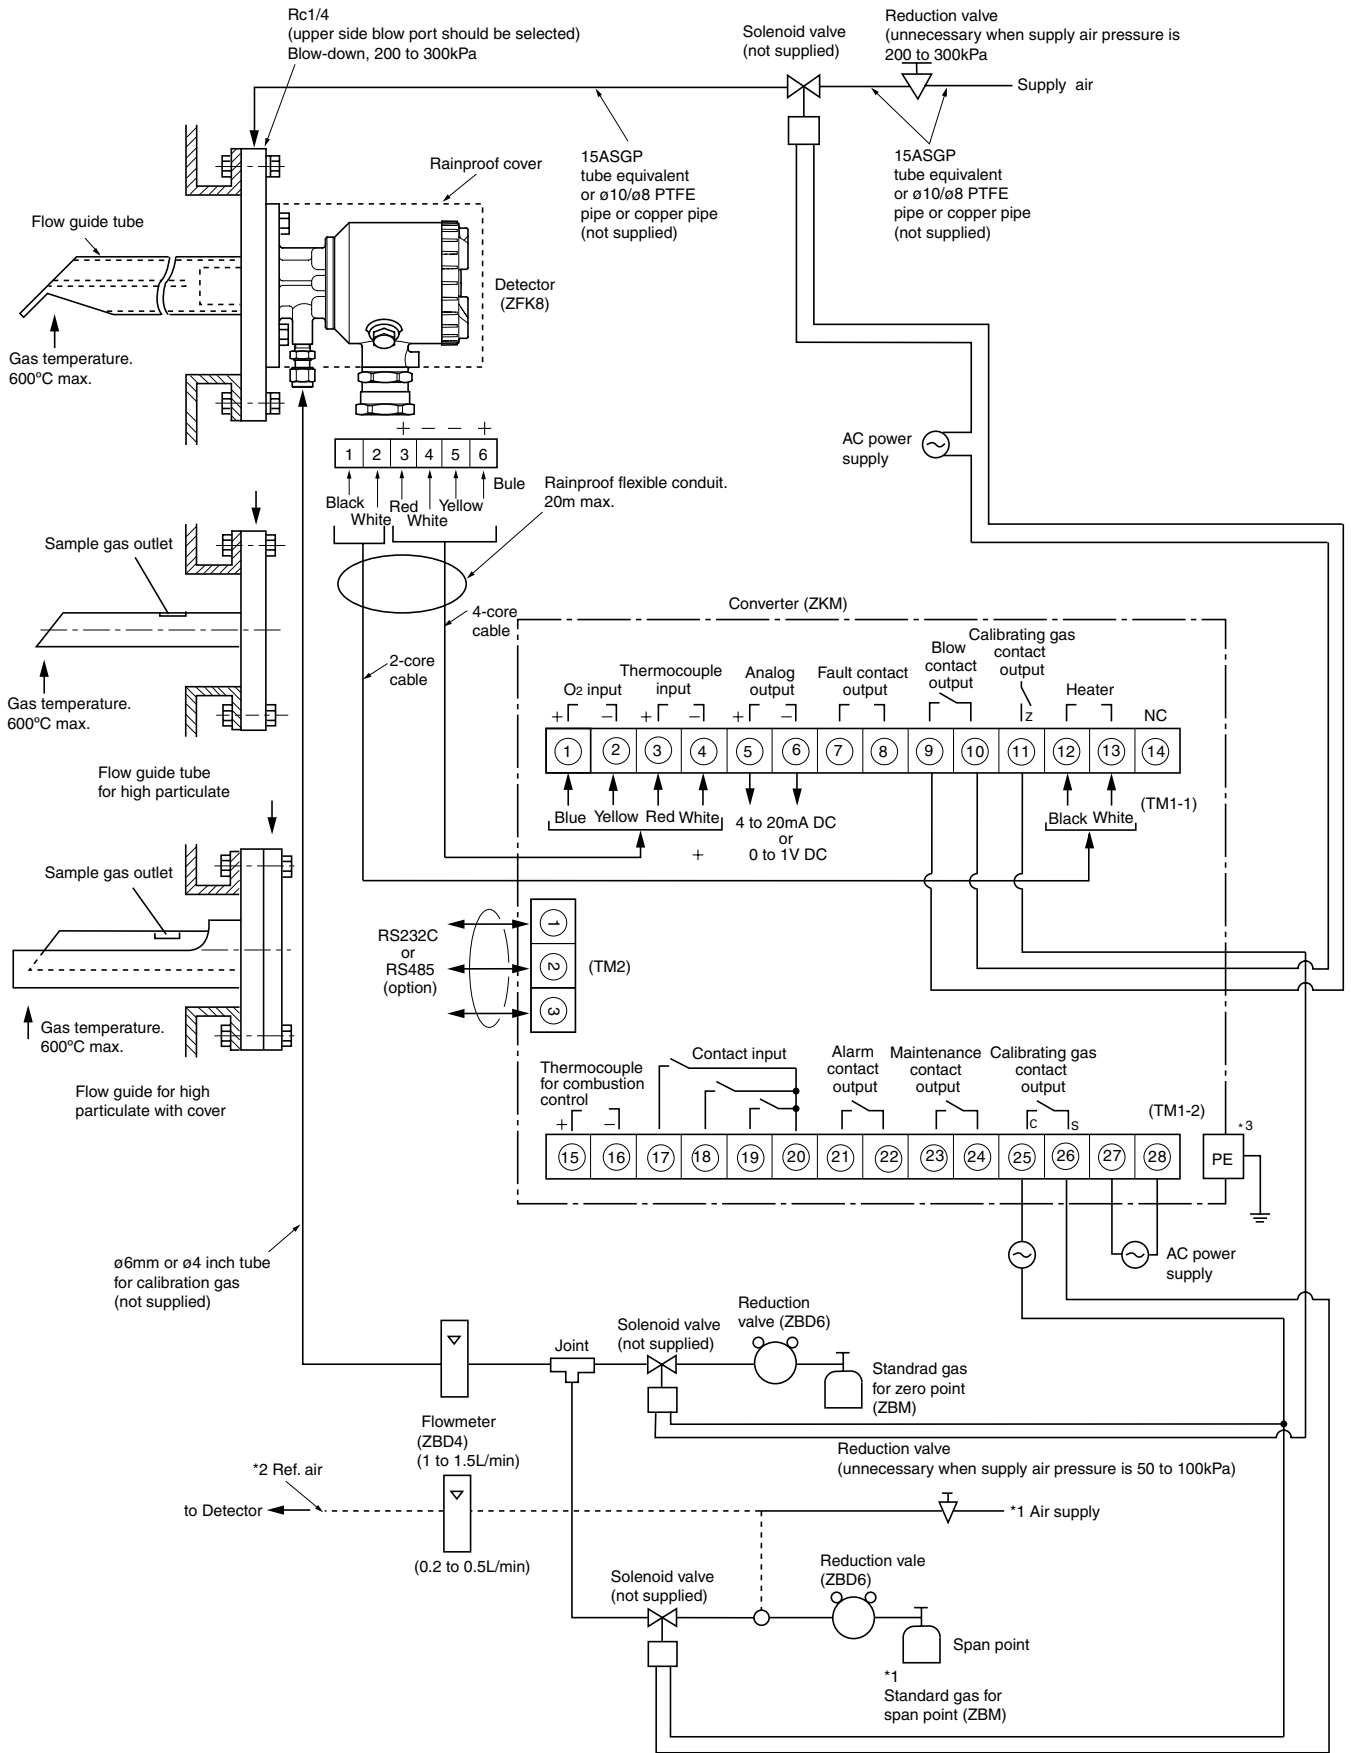

Note: *1 Standard gas or instrumentation air can be used in place of span gas.
 *2 Instrument quality air or bottled air is available as reference air instead of ambient air.
 *3 Protective earth.

Ejector system

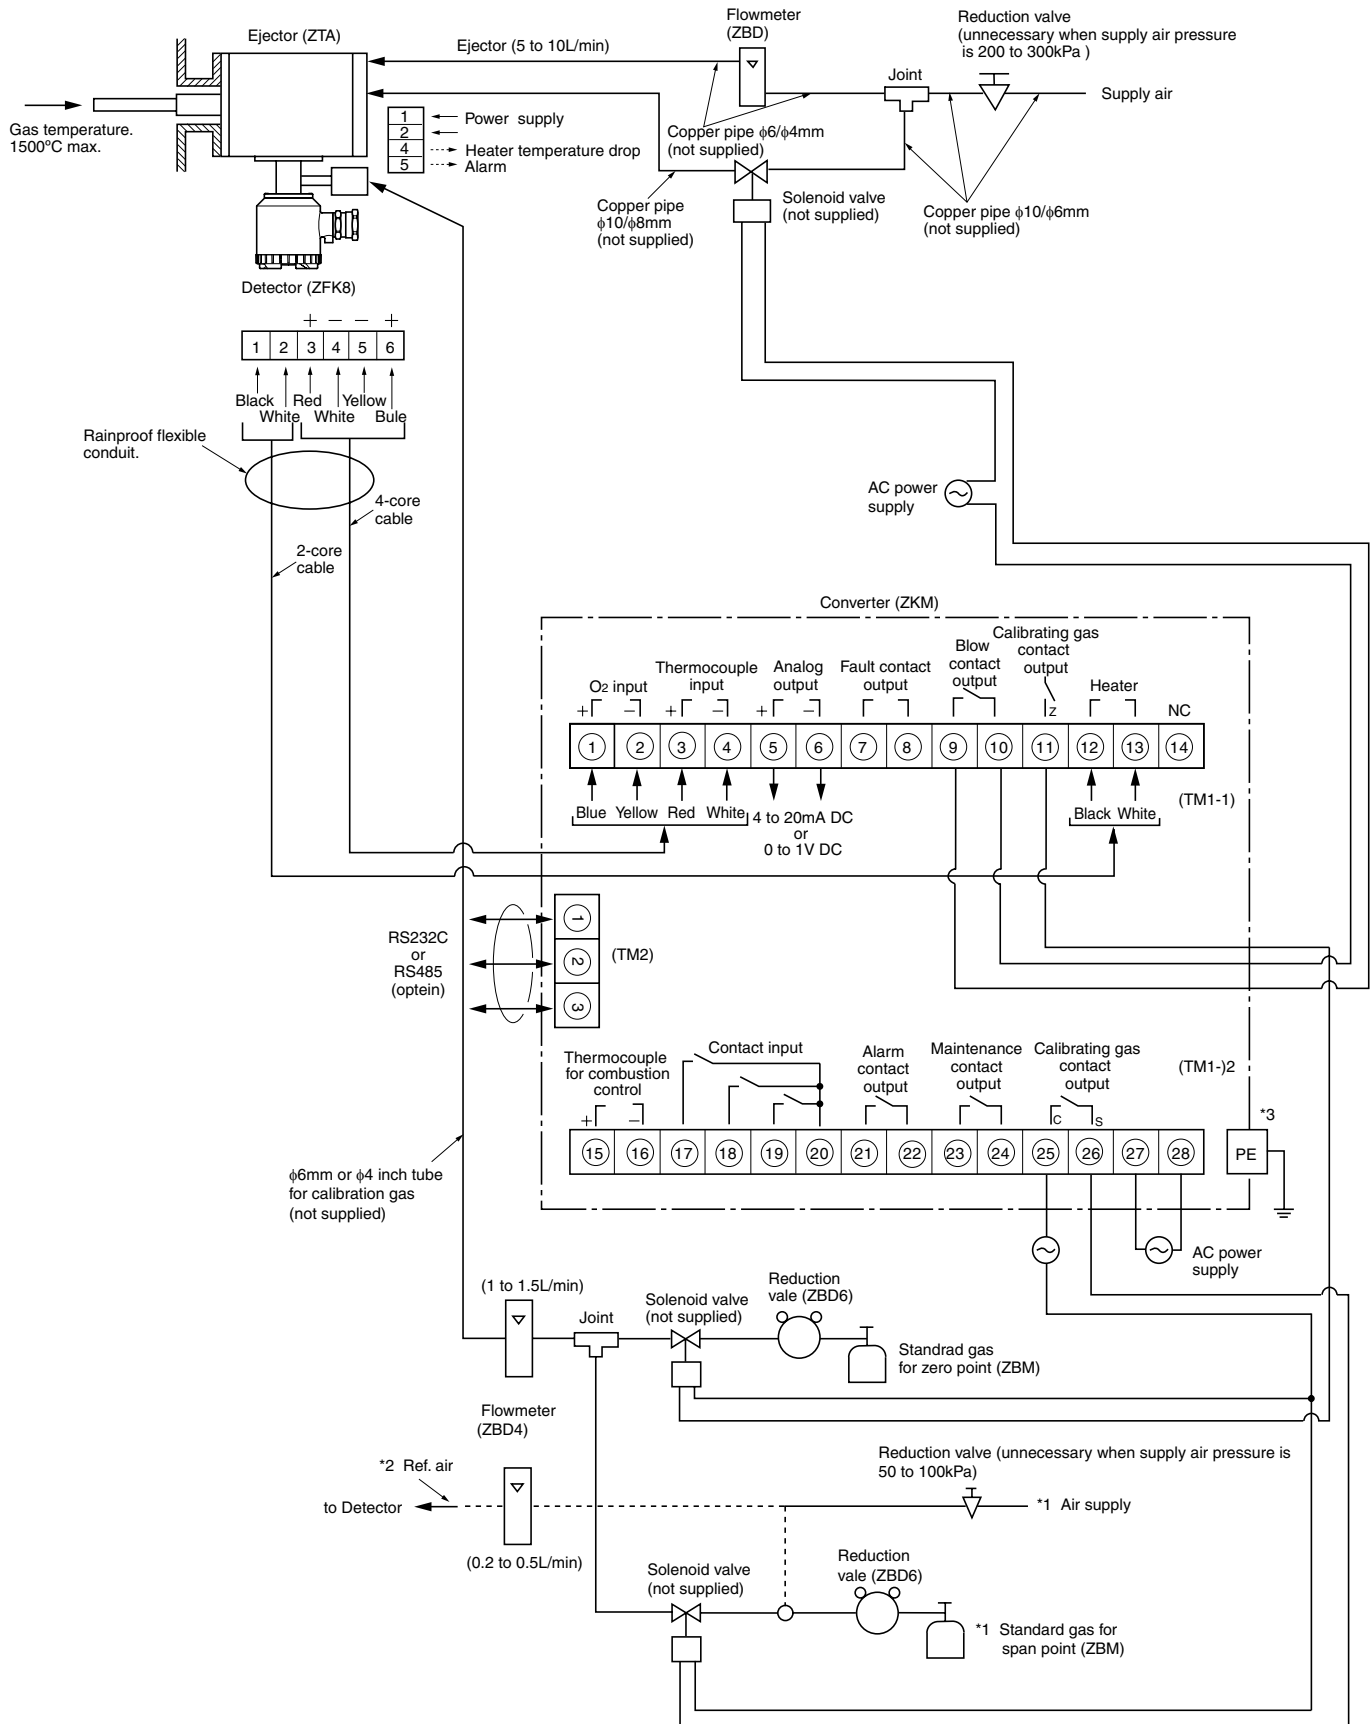

Note: *1 Standard gas or instrumentation air can be used in place of span gas.
 *2 Instrument quality air or bottled air is available as reference air instead of ambient air.
 *3 Protective earth.

DEVICE CONFIGURATION


The device to be combined differ according to the conditions of the gas to be measured. Select the devices to be combined with reference to the following table.

Application	Temperature	Gas Flow	Measured gas			Device configuration		
			DUST	Protection cover	Note	Detector type	Converter type	Ejector type
General-use (boiler)	600°C or less	5 to 20m/s	Less than 0.2g/m ³	—	Fuel; gas, oil	ZFK8R□□5-□A5□□-1□	ZKM	—
			Less than 10g/Nm ³	—	Fuel: coal with blow down	ZFK8R□□5-□C5□□-1□	ZKM	—
For corrosive gas (refuse incinerator)	600°C or less	5 to 20m/s	Less than 1g/Nm ³	—	Included low moisture	ZFK8R□□5-□B5□□-2□	ZKM	—
			Less than 10g/Nm ³	—	Included low moisture with blow down	ZFK8R□□5-□C5□□-2□	ZKM	—
			Less than 25g/Nm ³	no	Included low moisture with blow down	ZFK8R□□5-□D6□□-2□	ZKM	—
			Less than 25g/Nm ³	yes	Included high moisture with blow down	ZFK8R□□5-□E6□□-2□	ZKM	—
General-use (boiler)	800°C or less	Less than 1m/s	Less than 1g/Nm ³	—	SUS316 tube with blow down	ZFK8R□□5-0Y0□□-1□	ZKM	ZTA1
	1590°C or less	Less than 1m/s	Less than 1g/Nm ³	—	SIC tube with blow down	ZFK8R□□5-0Y0□□-1□	ZKM	ZTA2


Note (1) Dust volume is approximate value.

(2) Instrument quality air or bottled air is available as reference air by selecting detector with reference air inlet.


Flow guide tube (with blow-down nozzle)

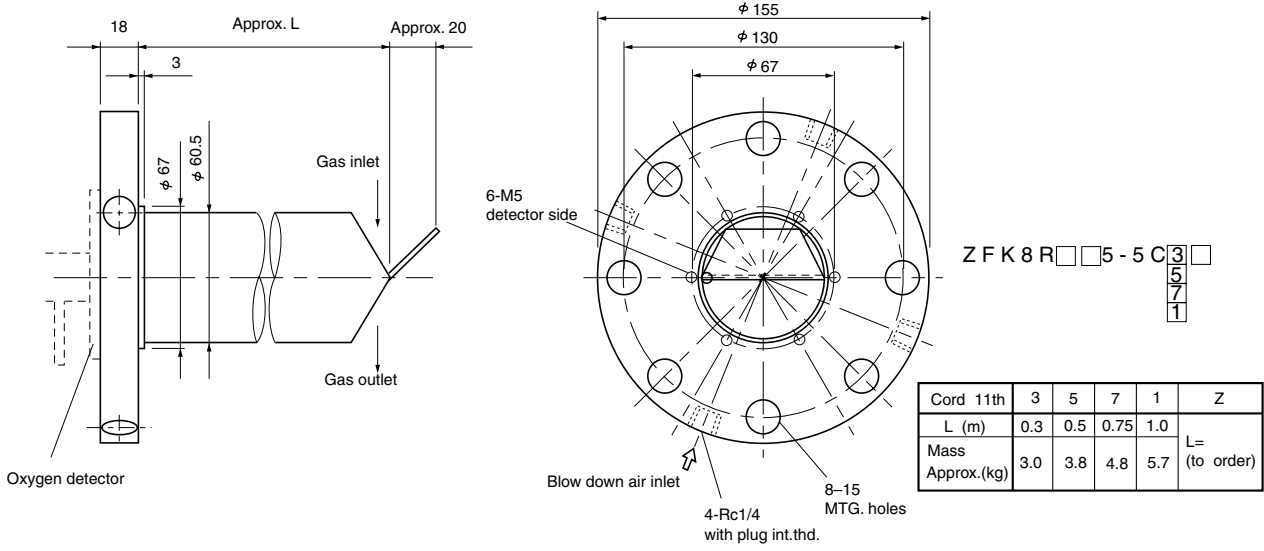

Flow guide tube (for high particulate)

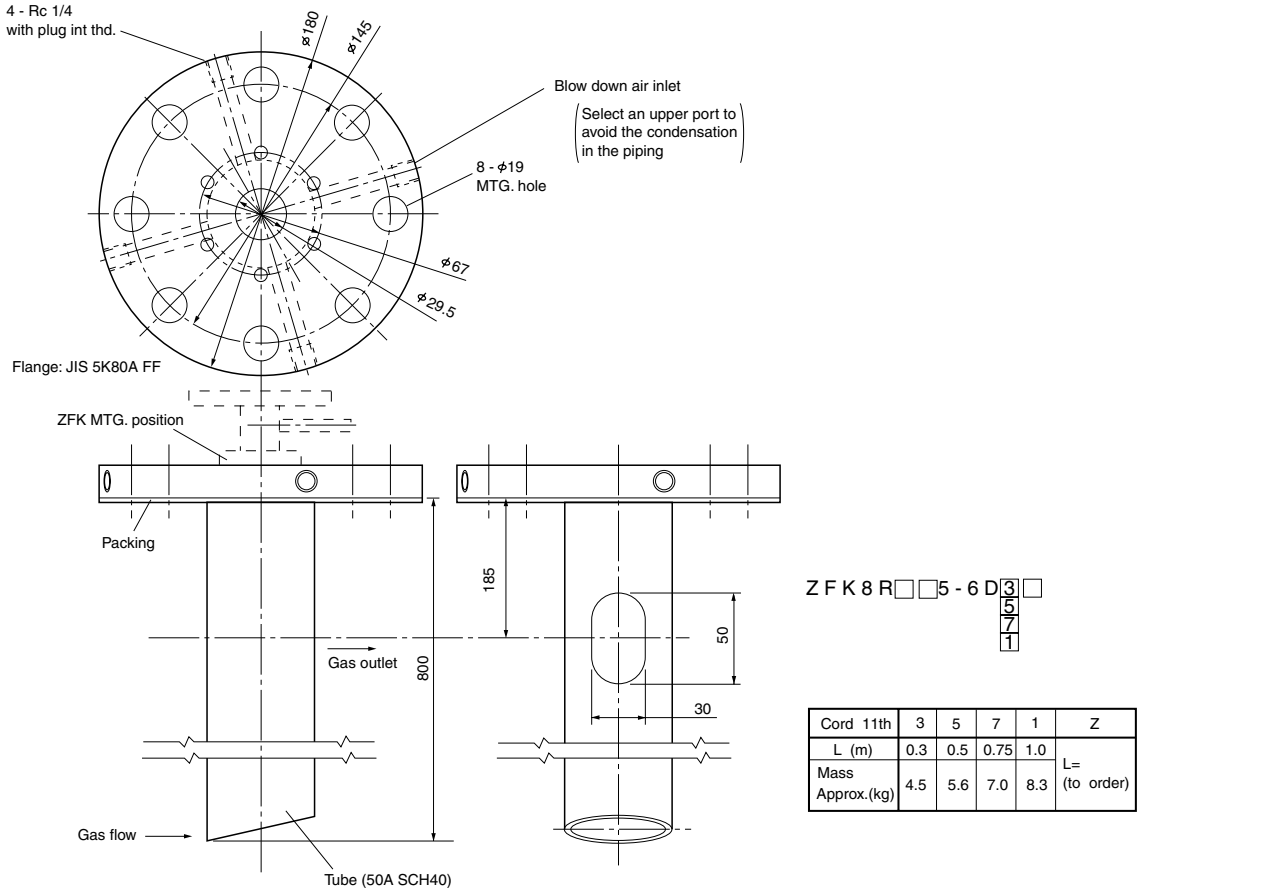


Flow guide tube (for high particulate with cover)

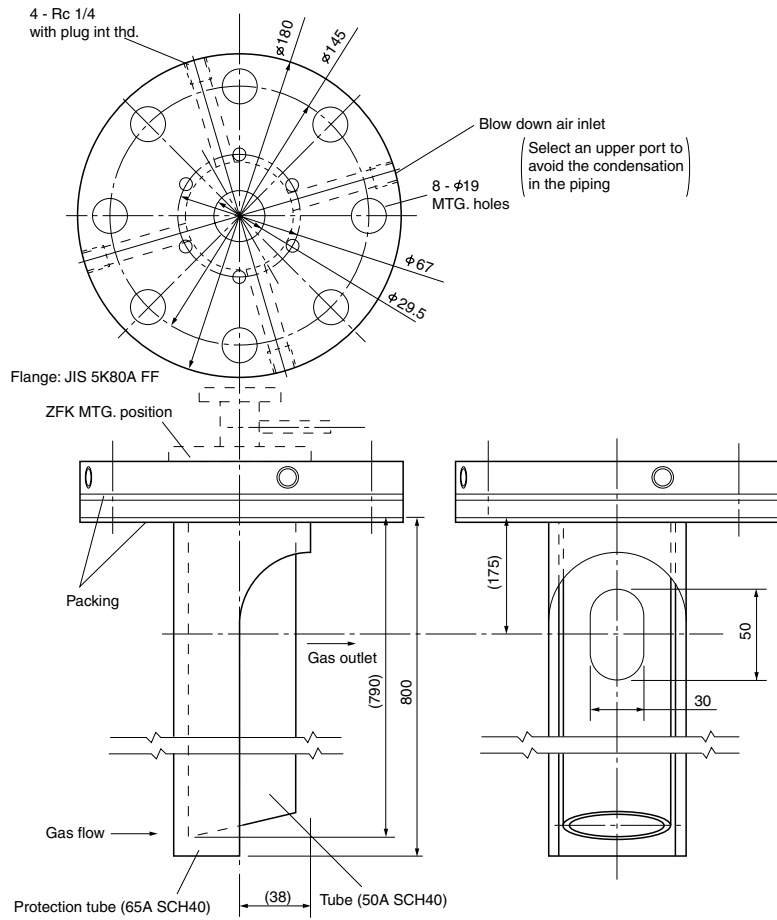

Z F K 8 R □ □ 5 - 6 E $\begin{matrix} 3 \\ 5 \\ 7 \\ 1 \end{matrix}$ □

Cord 11th	3	5	7	1	Z
L (m)	0.3	0.5	0.75	1.0	L= (to order)
Mass Approx.(kg)	7.1	9.0	11.4	13.6	


Flow guide tube

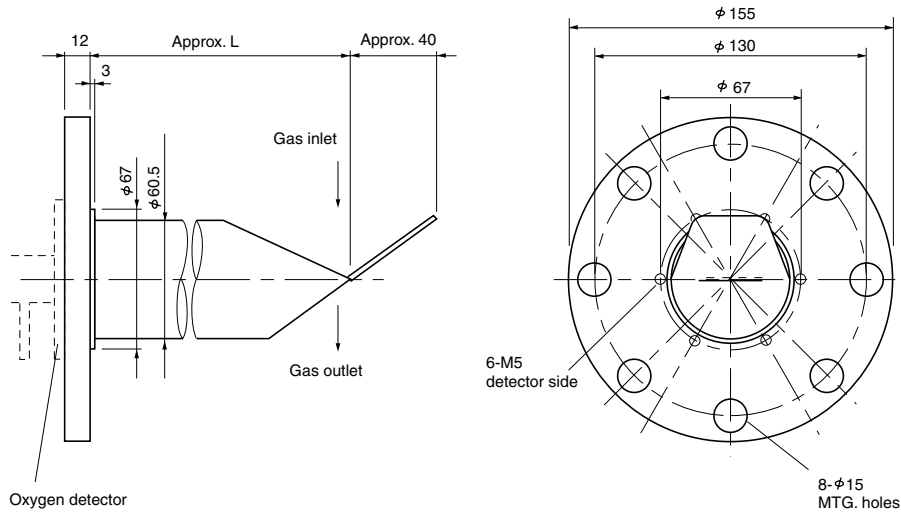


Z F K 8 R □ □ 5 - 5 B $\begin{matrix} 3 \\ 5 \\ 7 \\ 1 \end{matrix}$ □

Cord 11th	3	5	7	1	Z
L (m)	0.3	0.5	0.75	1.0	L= (to order)
MASS Approx.(kg)	3.3	4.5	6.1	7.6	

Ejector (ZTA)

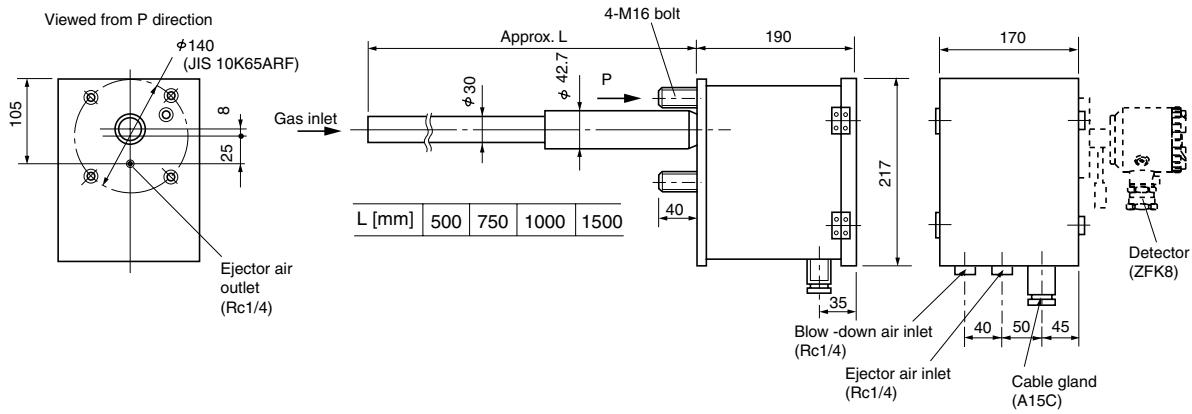

EXTERNAL CONNECTION DA DIAGRAM

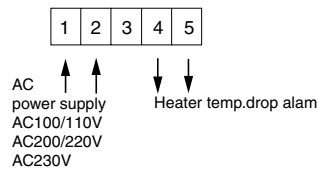

⚠ Caution on Safety

*Before using this product, be sure to read its instruction manual in advance.

Fuji Electric Systems Co., Ltd.

International Sales Div.1

Sales Group

Gate City Ohsaki, East Tower, 11-2, Osaki 1-chome,
Shinagawa-ku, Tokyo 141-0032, Japan

<http://www.fesys.co.jp/eng>

Phone: 81-3-5435-7280, 7281 Fax: 81-3-5435-7425

<http://www.fic-net.jp/eng>